



Data sheet

Thermo. operated water valve WVTS



Features

- Insensitive to dirt
- Insensitive to water pulsating pressure
- Proven reliable through decades
- Easy to service
- Built-in pilot filter

- Thermo. operated water valve type WVTS is suitable for controlling the temperature of a flow of water or neutral brine.
- WVTS opens on rising sensor temperature and is indirect servo operated thermostatic valve.
- It is suitable for controlling temperature in industrial applications by regulating the quantity of cooling water or neutral brine that cools down the process.
- The valves are self-acting, i.e. they operate without the supply of auxiliary energy such as electricity or compressed air.
- The required temperature is maintained constant without unnecessary use of cooling water in cooling systems.
- The operating economy and-efficiency are maximized.

- Long lifetime
- High performance
- Very high capacity
- Both welding and thread connection flanges



Data sheet | Thermo. operated water valve, WVTS

Technical data

Туре	WVTS for neutral media			
Operation	Servo-operated			

Sensor side


Temperature range	0 – 30 °C	25 – 65 °C	50 – 90 °C
Max. sensor temperature	57 °C	90 °C	125 °C

Liquid side

Media	Fresh water, neutral brine			
Media temperature range	- 25 – 90 °C			
Permissible working pressure PB	10 bar			
Max. test pressure	16 bar			
Opening differential pressure	WVTS 32 – WVTS 40: min. 0.5 bar; max. 4 bar			
	WVTS 50 – WVTS 100: min. 0.3 bar; max. 4 bar			

Valves are supplied with capillary tube gland. Different lengths of capillary tube are available. If WVTS is required with an opening differential pressure of 1 – 10 bar, the valve servo spring must be replaced. See "Ordering".

Ordering



WVTS components


			Code no.				
Valve type	Connection	k _v value ²) [m³/h]	Valve housing	Flange set ³)	Special servo spring for differential pressure range 1 – 10 bar		
WVTS 32	G 1¼ ¹)	12.5	016D5032	_	016D1327		
WVTS 40	G 1½ ¹)	21.0	016D5040	_	016D0575		
WVTS 50	2 in. weld fl.	32.0	016D5050 ⁴)	027N3050	016D0576		
WVTS 65	2½ in. weld fl.	45.0	016D5065 4)	027N3065	016D0577		
WVTS 80	3 in. weld fl.	80.0	016D5080 4)	027N3080	016D0578		
WVTS 100	4 in. weld fl.	125.0	016D5100 ⁴)	027N3100	016D0579		

¹) ISO 228-1.

²) The k_v value is the flow quantity of water in [m³/h] with a pressure drop across the value of 1 bar, $p = 1000 \text{ kg/m}^3$.

³) Code nos. include 2 flanges.

⁴) Code nos. include valve housing, flange gakets, flange bolts and screws for pilot valve.



WVTS, thermostatic pilot element ')

Range [°C]	Capillary tube length [m]	Code no.				
0 – 30	2	016D1002				
25 – 65	2	016D1003				
50 – 90	2	016D1004				
0 – 30	5	016D1005				
25 – 65	5	016D1006				
50 – 90	5	016D1007				
1) The vilat element is alreaded control element and						

¹) The pilot element includes control element and spring housing.


Accessories


Description	Code no.
Immersion sensor (sensor pocket)	003N0050
Capillary tube gland ¹)	003N0155

¹) 1 capillary tube gland supplied as standard accessory



Material - parts in contact with the medium

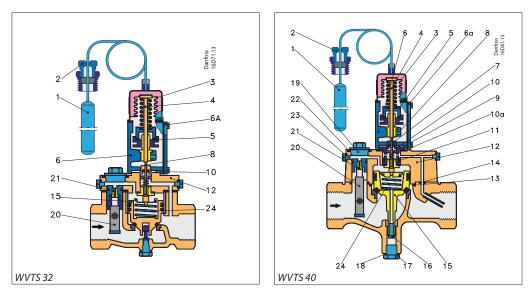

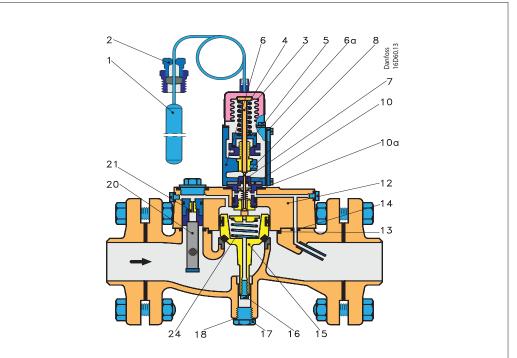

WVTS 50 - WVTS 100

The valve body is made of cast iron with pressed-in bronze seat. The pilot orifice assembly (7) consists of a

housing with seat and pilot cone of stainless steel.

A filter cartridge (20) is built into the valve cover. Here the equalising orifice is protected by a replaceable filter.

The bellows in the bellows element (3) are of tin bronze. In designing WVTS, great emphasis was placed on producing a valve with a completely tight seat and no external leakage. The servo piston was therefore fitted with a ring of special rubber that creates an elastic seal against the valve seat. A specially designed rubber sleeve ensures that the servo piston moves in the cylinder with minimum friction.

External valve leakage is prevented at the pilot cone where the spindle is fitted with Teflon cupwashers.


Cover gaskets and pilot channel seals are rubber.

The water-tight rubber seal between cover (6a) and housing (6) ensure that moisture cannot enter and freeze up the spindle. The insulating washer (10) prevents heat transmission between valve body and setting element housing.

- 1. Sensor
- 2. Gland 3. Bellows element
- 3. Bellows elemen
- 4. Pressure rod 5. Regulating nut
- 6. Setting element housing
- 6a. Cover
- 7. Pilot orifice assembly
- 8. Pilot cone
- 10. Insulating washer
- 12. Valve cover
- 15. Servo piston 20. Filter cartridge (self-cleaning)
- 21. Equalising orifice
- 24. Servo spring



Capacity

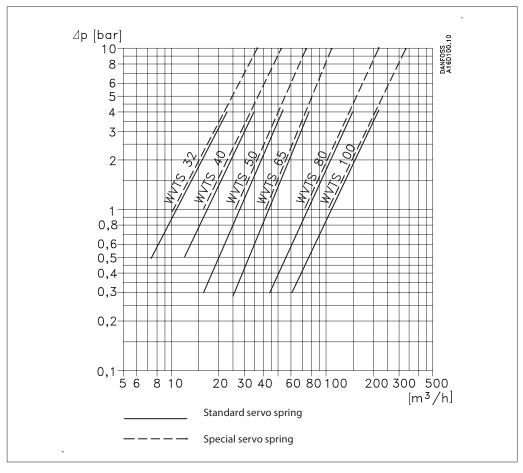


The capacity curves show the capacity (water quantity in $[m^3/h]$) of the individual valve sizes as a function of pressure drop across the valve.

The capacities are given for approx. 85% valve opening and are obtained with an offset of 4 °C (temperature rise at sensor) on both upper and lower temperature ranges.

Danfoss

Dimensions [mm] and weights [kg]

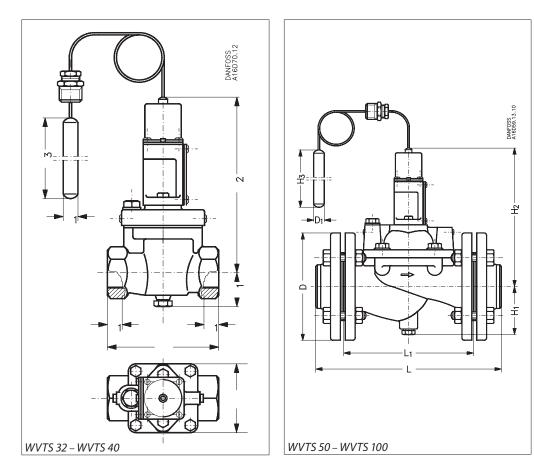

ENGINEERING TOMORROW

Туре	H1	H₂	H₃	L	Lı	В	øD	øD1	Net weight
WVTS 32	42	196	210	138	20	85	_	18	4
WVTS 40	72	224	210	198	30	100	—	18	7
WVTS 50	78	230	210	315	218		165	18	19
WVTS 65	82	246	210	320	224	—	185	18	24
WVTS 80	90	278	210	370	265	—	200	18	34
WVTS 100	100	298	210	430	315		220	18	44

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.