

## Data sheet

# Differential pressure and flow controller (PN 25)

**AVPQ** - return mounting, adjustable setting

**AVPQ 4** - flow mounting, adjustable setting

### Description



AVPQ(4) is a self-acting differential pressure and flow controller primarily for use in district heating systems. The controller closes on rising differential pressure or when set max. flow is exceeded.

The controller has a control valve with adjustable flow restrictor, an actuator with two control diaphragms and handle for differential pressure setting.

#### Main data:

- DN 15-50
- $k_{vs}$  0,4-25 m<sup>3</sup>/h
- Flow range: 0,015-15 m<sup>3</sup>/h
- PN 25
- Setting range: 0,2-1,0 bar/0,3-2,0 bar
- Flow restrictor  $\Delta p_b$ : 0,2 bar
- Temperature:  
Circ. water / glycolic water up to 30% :  
2 ... 150 °C
- Connections:
  - Ext. thread (weld-on, ext. thread and flange tailpieces)
  - Flange

### Ordering

*Example:*  
*Differential pressure and flow controller; return mounting;*  
*DN 15;  $k_{vs}$  1,6; PN 25;*  
*setting range 0,2-1,0 bar;*  
 *$T_{max}$  150 °C; ext. thread*


- 1x AVPQ DN 15 controller  
Code No: **003H6531**
- 1x Impulse tube set AV, R 1/8  
Code No: **003H6852**

#### Option:

- 1x Weld-on tailpieces  
Code No: **003H6908**

*The controller will be delivered completely assembled, inclusive impulse tube(s) between valve and actuator. External impulse tube (AV) must be ordered separately.*

### AVPQ Controller (return mounting)

Picture	DN (mm)	$k_{vs}$ (m <sup>3</sup> /h)	Connection	$\Delta p$ setting range (bar)	Code No.	$\Delta p$ setting range (bar)	Code No.
	15	0,4	Cylindr. ext. thread acc. to ISO 228/1	G 3/4 A	0,2-1,0	003H6918	003H6920
		1,0				003H6919	
		1,6				003H6531	
		2,5				003H6532	
		4,0				003H6533	
	20	6,3		G 1 A	0,3-2,0	003H6534	003H6542
		8,0		G 1 1/4 A		003H6535	
		12,5		G 1 1/4 A		003H6536	
		16		G 2 A		003H6537	
		20		G 2 1/2 A		003H6538	
	32	12,5	Flanges PN 25, acc. to EN 1092-2			003H6563	003H6566
		20				003H6564	
		25				003H6565	

## Ordering (continuous)

## AVPQ 4 Controller (flow mounting)

Picture	DN (mm)	$k_{vs}$ (m³/h)	Connection	$\Delta p$ setting range (bar)	Code No.	$\Delta p$ setting range (bar)	Code No.
	15	0,4	G ¾ A Cylindr. ext. thread acc. to ISO 228/1	0,2-1,0	003H6922	0,3-2,0	003H6924
		1,0			003H6923		003H6925
		1,6			003H6547		003H6555
		2,5			003H6548		003H6556
		4,0			003H6549		003H6557
		6,3	G 1 A		003H6550		003H6558
		8,0	G 1¼ A		003H6551		003H6559
		12,5	G 1½ A		003H6552		003H6560
		16	G 2 A		003H6553		003H6561
		20	G 2½ A		003H6554		003H6562
		12,5	Flanges PN 25, acc. to EN 1092-2		003H6569		003H6572
		20			003H6570		003H6573
		25			003H6571		003H6574

## Accessories

Picture	Type designation	DN	Connection	Code No.
	Weld-on tailpieces	15	-	003H6908
		20		003H6909
		25		003H6910
		32		003H6911
		40		003H6912
		50		003H6913
	External thread tailpieces	15	Conical ext. thread acc. to EN 10226-1	R ½ 003H6902
		20		R ¾ 003H6903
		25		R 1 003H6904
		32		R 1¼ 003H6905
		40		R 1½ 065B2004
		50		R 2 065B2005
	Flange tailpieces	15	Flanges PN 25, acc. to EN 1092-2	003H6915
		20		003H6916
		25		003H6917
	Impulse tube set AV	Description: - 1x copper tube Ø6 x 1 x 1500 mm - 1x compression fitting 1) for imp. tube connection to pipe Ø6 x 1 mm		R ¼ 003H6852
	) 10 compression fittings for imp. tube connection to pipe, Ø6 x 1 mm R ¼		R ½ 003H6853	
	) 10 compression fittings for imp. tube connection to pipe, Ø6 x 1 mm R ¾		R ½ 003H6854	
	) 10 compression fittings for imp. tube connection to pipe, Ø6 x 1 mm R ½		003H6857	
	) 10 compression fittings for imp. tube connection to actuator, Ø6 x 1 mm G ½		003H6858	
	Shut off valve Ø6 mm			003H6859
				003H6931
				003H0276

<sup>1)</sup> Compression fitting consists of a nipple, compression ring and nut.

## Ordering (continuous)

## Service kits

Picture	Type designation	DN	$k_{vs}$ (m³/h)	Code No.
	Valve insert	15	0,4	003H6861
			1,0	003H6862
			1,6	003H6863
			2,5	003H6864
			4,0	003H6865
		20	6,3	003H6866
		25	8,0	003H6867
		32 / 40 / 50	12,5 / 16 / 20 / 25	003H6868

Picture	Type designation	$\Delta p$ setting range (bar)	Code No.	
			AVPQ	AVPQ 4
	Actuator with adjustable handle	0,2-1,0	003H6833	003H6838
		0,3-2,0	003H6850	003H6851

## Technical data

## Valve

Nominal diameter		DN	15		20	25	32	40	50										
k <sub>vs</sub> value  Range of max. flow setting $\Delta p_b$ <sup>1)</sup> = 0,2 bar	from to or to <sup>3)</sup>	m <sup>3</sup> /h	0,4	1,0	1,6	2,5	4,0	6,3	8,0	12,5	16/20 <sup>4)</sup>	20/25 <sup>4)</sup>							
			0,015	0,02	0,03	0,07	0,07	0,16	0,2	0,4	0,8	0,8							
			0,18	0,4	0,86	1,4	2,2	3,0	3,5	8,0	10	12							
			-	-	0,9	1,6	2,4	3,5	4,5	10	12	15							
Cavitation factor z			$\geq 0,6$				$\geq 0,55$		$\geq 0,5$										
Leakage acc. to standard IEC 534			$\leq 0,02$							$\leq 0,05$									
Nominal pressure			PN							25									
Min. differential pressure			bar	see remark <sup>2)</sup>															
Max. differential pressure				20			16												
Medium			Circulation water / glycolic water up to 30%																
Medium pH			Min. 7, max. 10																
Medium temperature			°C	2 ... 150															
Connections	valve		External thread						Ext. thread and flange										
	tailpieces		Weld-on and external thread						Flange										
Materials																			
Valve body	thread		Red bronze CuSn5ZnPb (Rg5)						Ductile iron										
	flange		-						EN-GJS-400-18-LT (GGG 40.3)										
Valve seat			Stainless steel, mat. No. 1,4571																
Valve cone			Dezincing free brass CuZn36Pb2As																
Sealing			EPDM																
Pressure relieve system			Piston																

<sup>1)</sup>  $\Delta p_b$  - differential pressure over flow restrictor<sup>2)</sup> Depends on the flow rate and valve k<sub>vs</sub>; For Q<sub>set</sub> = Q<sub>max</sub> > Δp<sub>min</sub> ≥ 0,5 bar; For Q<sub>set</sub> < Q<sub>max</sub> -> Δp<sub>min</sub> =  $\left(\frac{Q}{k_{vs}}\right)^2 + \Delta p_b$ <sup>3)</sup> Higher max flow are achieved at higher differential pressures over AVPQ(4) controller. In general at Δp > 1-1,5 bar<sup>4)</sup> Flange valve body


## Technical data (continuous)

## Actuator


Type	AVPQ	AVPQ 4
Actuator size	cm <sup>2</sup>	54
Nominal pressure	PN	25
Flow restrictor diff. pressure, $\Delta p_b$	bar	0,2
Diff. pressure setting ranges and spring colours	bar	0,2-1,0 yellow      0,3-2,0 red      0,2-1,0 yellow      0,3-2,0 red
Materials		
Housing	Upper casing of actuator	Stainless steel, mat. No.1,4301
	Lower casing of actuator	Dezincing free brass CuZn36Pb2As
Diaphragm		EPDM
Impulse tube		Copper tube Ø6 x 1 mm

## Application principles

## - Return mounting

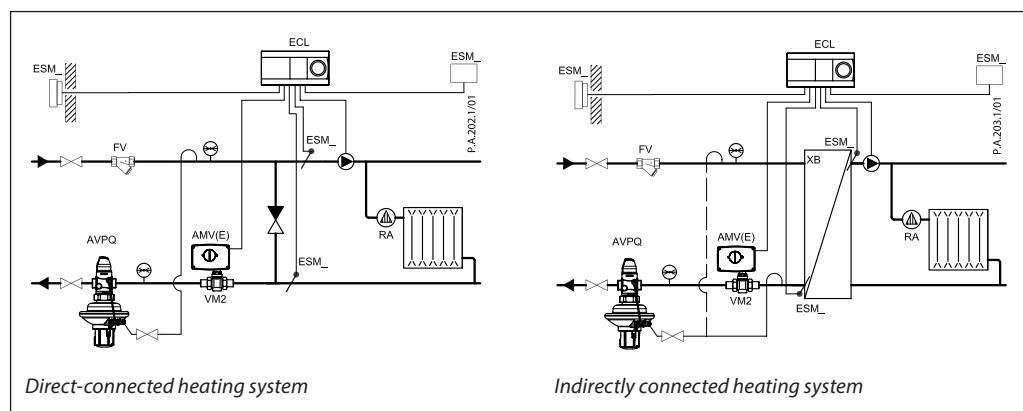



## - Flow mounting

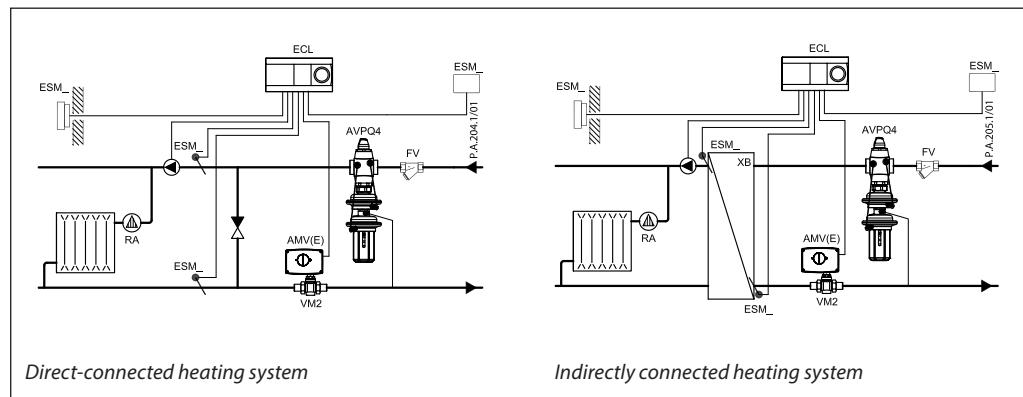


## Installation positions


Up to medium temperature of 100 °C the controllers can be installed in any position.

For higher temperatures the controllers have to be installed in horizontal pipes only, with a pressure actuator oriented downwards.

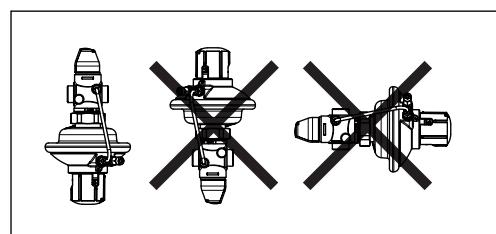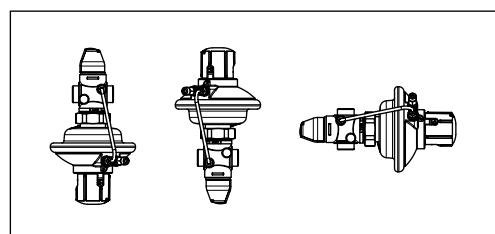

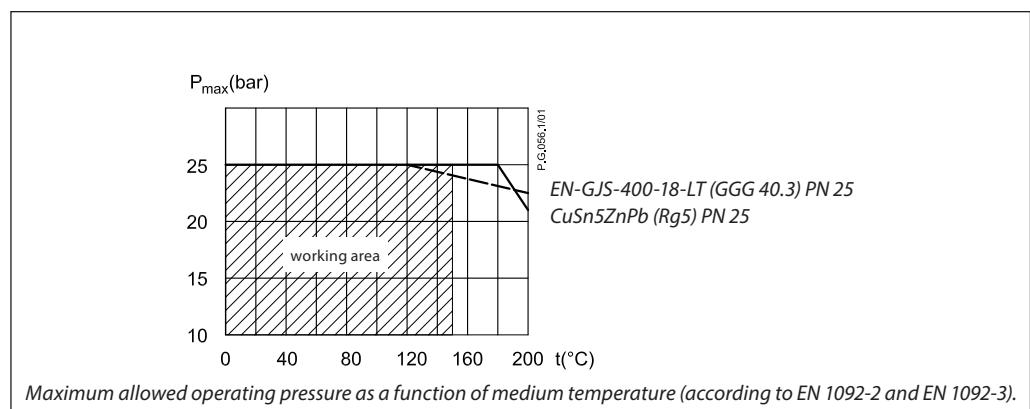**Pressure temperature diagram**

**Flow diagram**
*Sizing and setting diagram*

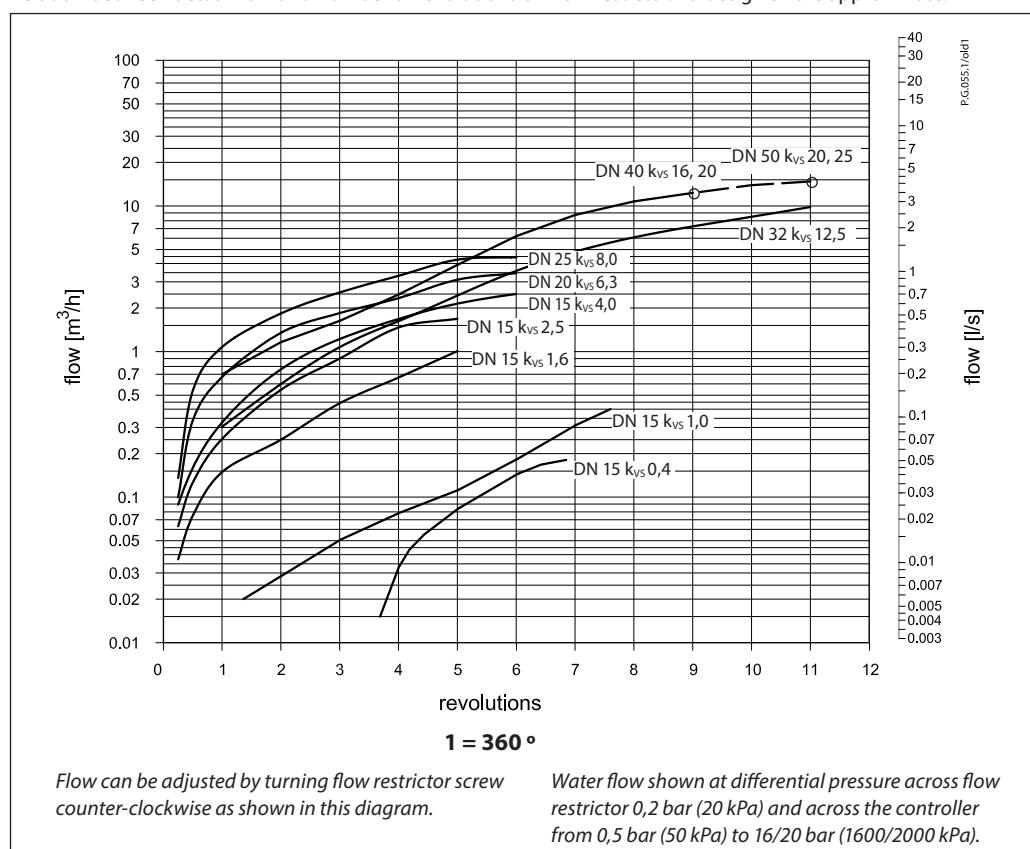Relation between actual flow and number of revolutions on flow restrictor. Values given are approximate.


**Remark:**

Controllers DN 40 and DN 50 have the same curve up to 9 revolutions.

**Note:**

For max flow setting on the controller diagrams from Instructions should be used.

## Sizing

- Directly connected heating system

## Example 1

Motorised control valve (MCV) for mixing circuit in direct-connected heating system requires differential pressure of 0,3 bar (30 kPa) and flow less than 1900 l/h.

## Given data:

$$\begin{aligned} Q_{\max} &= 1,9 \text{ m}^3/\text{h} (1900 \text{ l/h}) \\ \Delta p_{\min} &= 0,9 \text{ bar (90 kPa)} \\ \Delta p_{\text{circuit}}^1) &= 0,1 \text{ bar (10 kPa)} \\ \Delta p_{\text{MCV}} &= 0,3 \text{ bar (30 kPa) selected} \\ \Delta p_b^2) &= 0,2 \text{ bar (20 kPa)} \end{aligned}$$

## Remark:

<sup>1)</sup>  $\Delta p_{\text{circuit}}$  corresponds to the required pump pressure in the heating circuit and is not to be considered when sizing the AVPQ(4).

<sup>2)</sup>  $\Delta p_b$  is differential pressure over flow restrictor.

The differential pressure set value is:

$$\Delta p_{\text{set value}} = \Delta p_{\text{MCV}}$$

$$\Delta p_{\text{set value}} = 0,3 \text{ bar (30 kPa)}$$

The total pressure loss across the controller is:

$$\Delta p_{\text{AVPQ}} = \Delta p_{\min} - \Delta p_{\text{MCV}} = 0,9 - 0,3$$

$$\Delta p_{\text{AVPQ}} = 0,6 \text{ bar (60 kPa)}$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.



$k_v$  value is calculated according to formula:

$$k_v = \frac{Q_{\max}}{\sqrt{\Delta p_{\text{AVPQ}} - \Delta p_b}} = \frac{1,9}{\sqrt{0,6 - 0,2}}$$

$$k_v = 3,0 \text{ m}^3/\text{h}$$

## Solution:

The example selects AVPQ(4) DN 15,  $k_{vs}$  value 4,0, with differential pressure setting range 0,2-1,0 bar, flow setting range 0,07-2,4 m<sup>3</sup>/h.

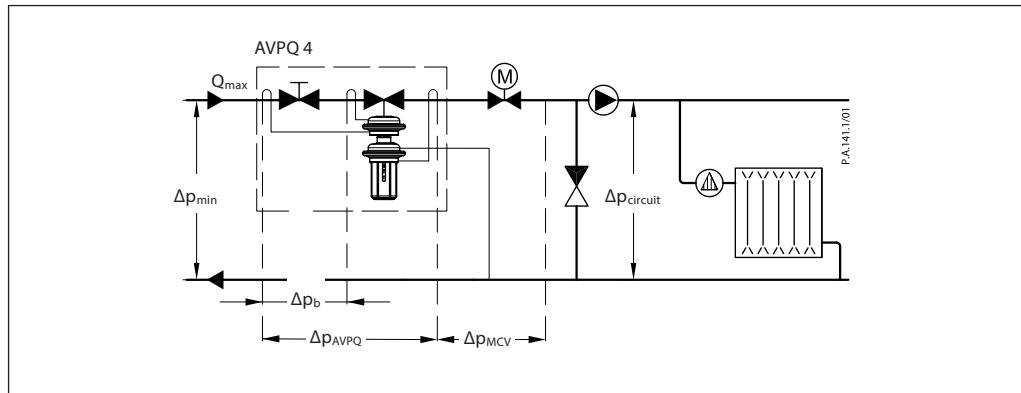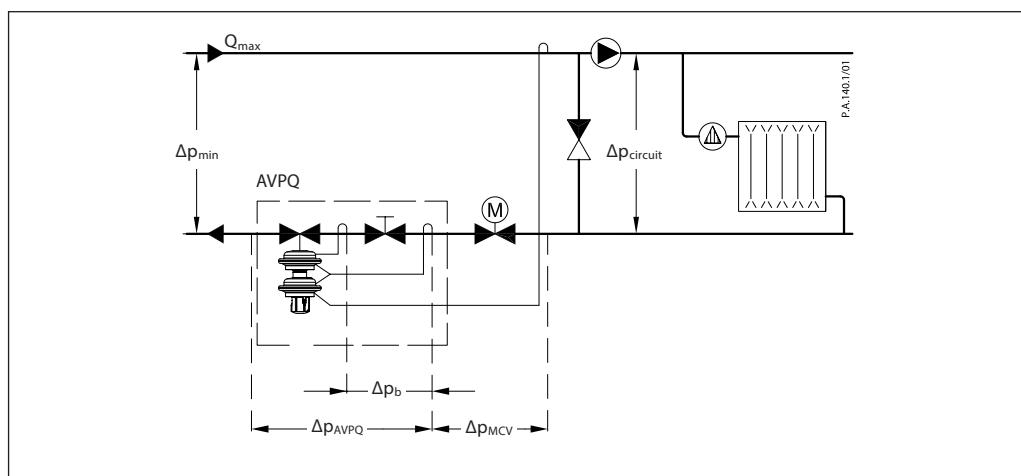

**Sizing (continuous)**

- Indirectly connected heating system

**Example 2**

Motorised control valve (MCV) for indirectly connected heating system requires differential pressure of 0,3 (30 kPa) bar and flow less than 1150 l/h.

**Given data:**

$$\begin{aligned} Q_{\max} &= 1,15 \text{ m}^3/\text{h} (1150 \text{ l/h}) \\ \Delta p_{\min} &= 1,0 \text{ bar (100 kPa)} \\ \Delta p_{\text{exchanger}} &= 0,05 \text{ bar (5 kPa)} \\ \Delta p_{\text{MCV}} &= 0,3 \text{ bar (30 kPa) selected} \\ \Delta p_b &= 0,2 \text{ bar (20 kPa)} \end{aligned}$$

*Remark:*

<sup>1)</sup>  $\Delta p_b$  is differential pressure over flow restrictor

The total pressure loss across the controller is:

$$\Delta p_{\text{AVPQ}} = \Delta p_{\min} - \Delta p_{\text{exchanger}} - \Delta p_{\text{MCV}}$$

$$\Delta p_{\text{AVPQ}} = 1,0 - 0,05 - 0,3$$

$$\Delta p_{\text{AVPQ}} = 0,65 \text{ bar (65 kPa)}$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.

$k_v$  value is calculated according to formula:

$$k_v = \frac{Q_{\max}}{\sqrt{\Delta p_{\text{AVPQ}} - \Delta p_b}} = \frac{1,15}{\sqrt{0,65 - 0,2}}$$


$$k_v = 1,7 \text{ m}^3/\text{h}$$

**Solution:**


The example selects AVPQ(4) DN 15,  $k_{vs}$  value 2,5, with differential pressure setting range 0,2-1,0 bar, flow setting range 0,07-1,6  $\text{m}^3/\text{h}$ .

The differential pressure set value is:

$$\begin{aligned} \Delta p_{\text{set value}} &= \Delta p_{\text{exchanger}} + \Delta p_{\text{MCV}} \\ \Delta p_{\text{set value}} &= 0,05 + 0,3 \\ \Delta p_{\text{set value}} &= 0,35 \text{ bar (35 kPa)} \end{aligned}$$

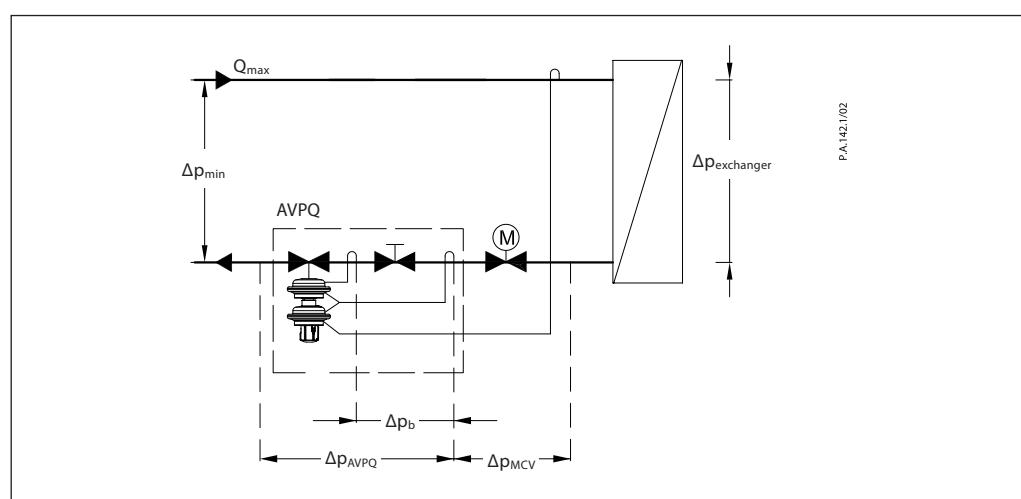


P.A.142.1/02

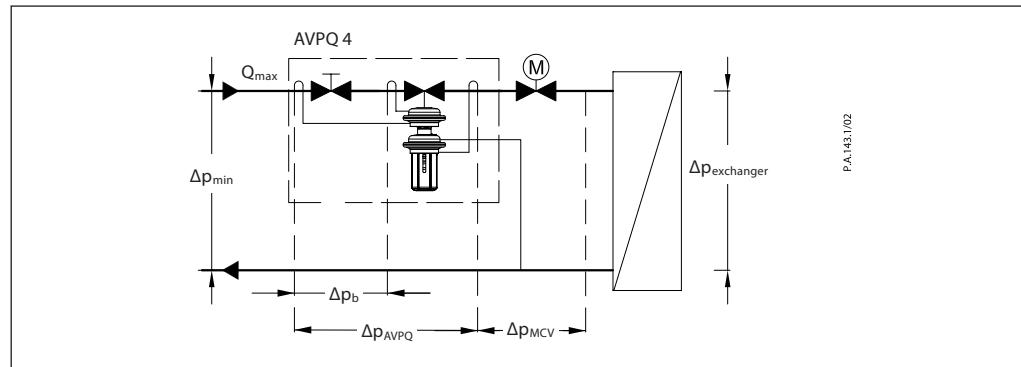

P.A.143.1/02

**Design**

1. Cover
2. Adjustable flow restrictor
3. Valve body
4. Valve insert
5. Pressure relieved valve cone
6. Valve stem
7. Control drain
8. Control diaphragm for flow control
9. Control diaphragm for diff. pressure control
10. Setting spring for diff. pressure control
11. Handle for diff. pressure setting, prepared for sealing
12. Adjuster for diff. pressure setting, prepared for sealing
13. Union nut
14. Compression fitting for impulse tube
15. Upper casing of actuator
16. Lower casing of actuator
17. Impulse tube
18. Excess pressure safety valve
19. Actuator

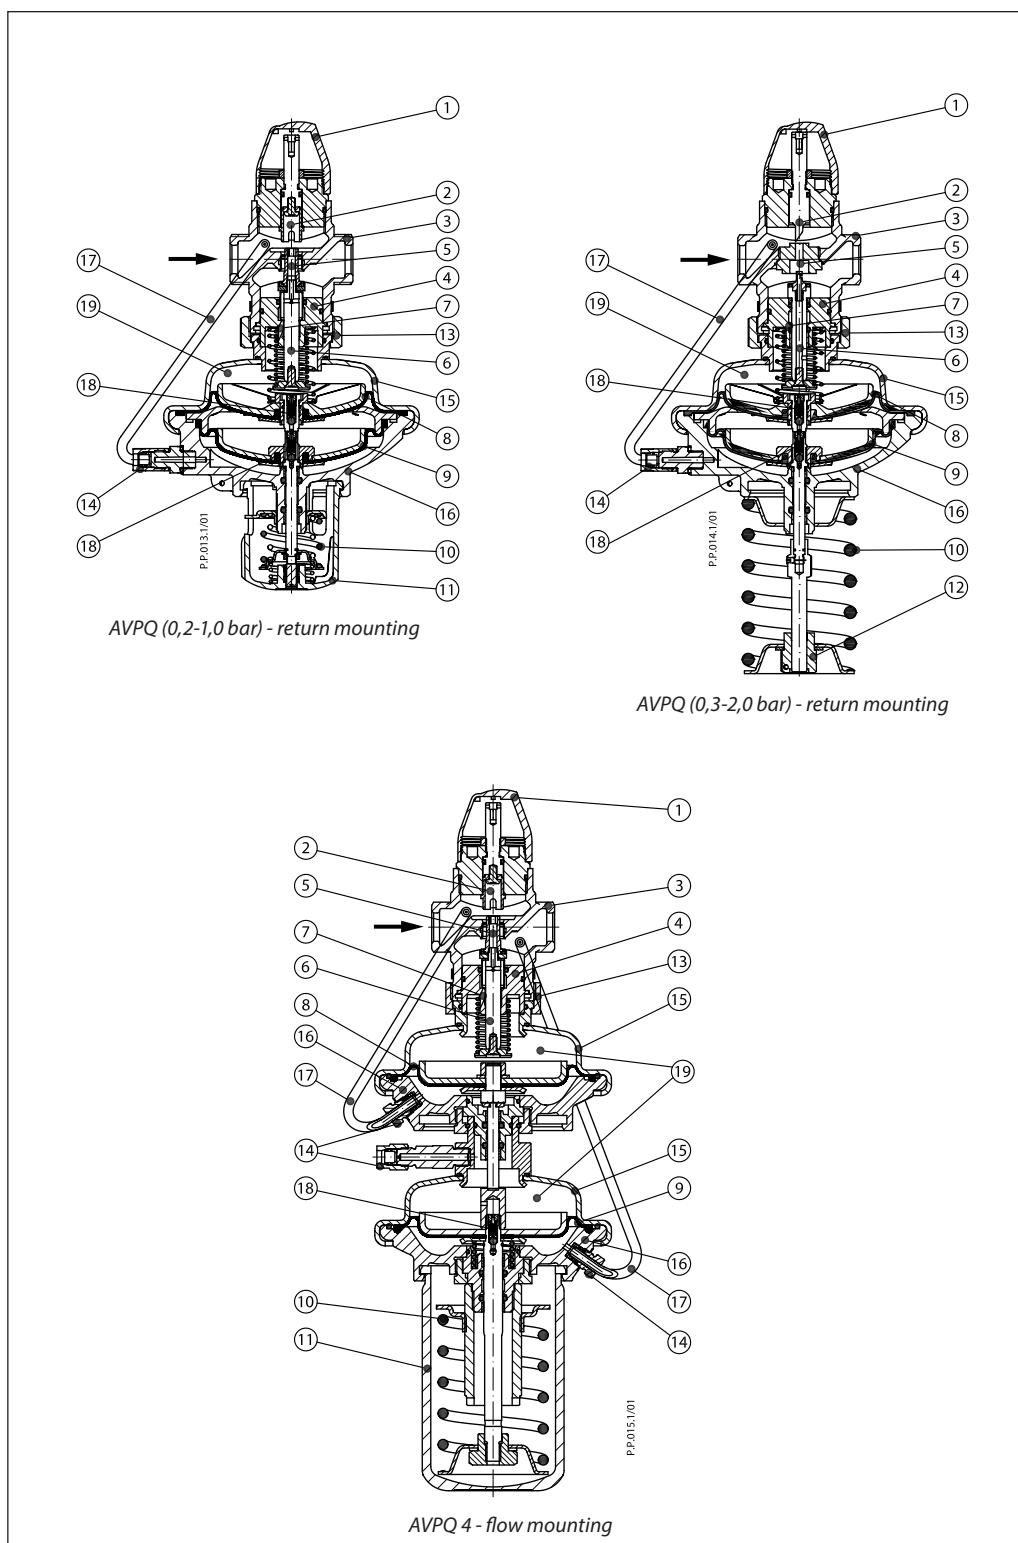

**Function**

Flow volume causes pressure drop across the adjustable flow restrictor. Resulting pressures are being transferred through the impulse tubes and/or control drain in the actuator stem to the actuator chambers and act on control diaphragm for flow control. The flow restrictor diff. pressure is controlled and limited by means of built-in spring for flow control. Control valve closes on rising differential pressure and opens on falling differential pressure to control max flow.

Pressure changes from flow and return pipes are being transferred through the impulse tubes to the actuator chambers and act on control diaphragm for diff. pressure control. The diff. pressure is controlled by means of setting spring for diff. pressure control. Control valve closes on rising differential pressure and opens on falling differential pressure to maintain constant differential pressure.

Controller is equipped with excess pressure safety valve, which protects control diaphragm for diff. pressure control from too high differential pressure. In addition return version of controller is equipped with second excess pressure safety valve, which protects control diaphragm for flow control from too high differential pressure.

**Settings**
*Flow setting*


Flow setting is being done by the adjustment of the flow restrictor position. The adjustment can be performed on the basis of flow adjustment diagram (see relevant instructions) and/or by the means of heat meter.

*Differential pressure setting*

Differential pressure setting is being done by the adjustment of the setting spring for diff. pressure control. The adjustment can be done by means of handle for diff. pressure setting and/or pressure indicators.

**Adjustment diagram**

*Relation between scale figures and differential pressure. Values given are approximate.*

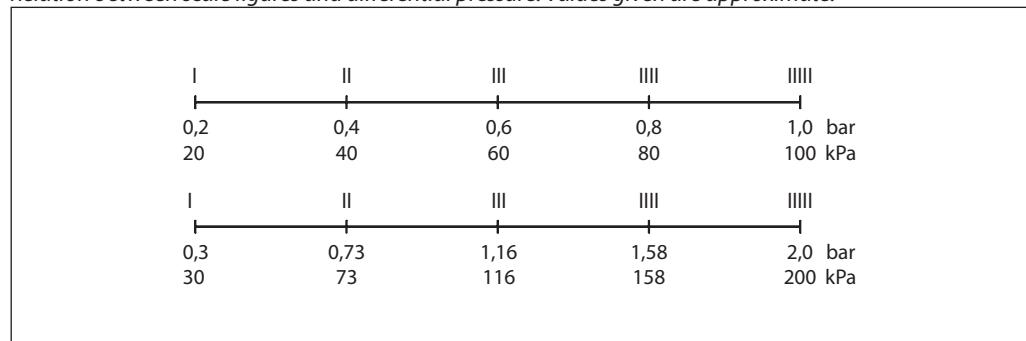

## Dimensions

<b>AVPQ</b> <b>DN 15-50</b> $\Delta p = 0,3-2,0 \text{ bar}$	<b>AVPQ</b> <b>DN 32-50</b> $\Delta p = 0,3-2,0 \text{ bar}$																																																															
<b>AVPQ (<math>\Delta p = 0,3-2,0 \text{ bar}</math>)</b>																																																																
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left; padding-bottom: 2px;">DN</th><th style="text-align: center; padding-bottom: 2px;">15</th><th style="text-align: center; padding-bottom: 2px;">20</th><th style="text-align: center; padding-bottom: 2px;">25</th><th style="text-align: center; padding-bottom: 2px;">32</th><th style="text-align: center; padding-bottom: 2px;">40</th><th style="text-align: center; padding-bottom: 2px;">50</th></tr> </thead> <tbody> <tr> <td style="text-align: left; vertical-align: bottom;">L</td><td style="text-align: center; vertical-align: bottom;">65</td><td style="text-align: center; vertical-align: bottom;">70</td><td style="text-align: center; vertical-align: bottom;">75</td><td style="text-align: center; vertical-align: bottom;">100</td><td style="text-align: center; vertical-align: bottom;">110</td><td style="text-align: center; vertical-align: bottom;">130</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">L1</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">180</td><td style="text-align: center; vertical-align: bottom;">200</td><td style="text-align: center; vertical-align: bottom;">230</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H</td><td style="text-align: center; vertical-align: bottom;">219</td><td style="text-align: center; vertical-align: bottom;">219</td><td style="text-align: center; vertical-align: bottom;">219</td><td style="text-align: center; vertical-align: bottom;">260</td><td style="text-align: center; vertical-align: bottom;">260</td><td style="text-align: center; vertical-align: bottom;">260</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H1</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">260</td><td style="text-align: center; vertical-align: bottom;">260</td><td style="text-align: center; vertical-align: bottom;">260</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H2</td><td style="text-align: center; vertical-align: bottom;">73</td><td style="text-align: center; vertical-align: bottom;">73</td><td style="text-align: center; vertical-align: bottom;">76</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H3</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">Weight (thread)</td><td style="text-align: center; vertical-align: bottom;">3,2</td><td style="text-align: center; vertical-align: bottom;">3,2</td><td style="text-align: center; vertical-align: bottom;">3,4</td><td style="text-align: center; vertical-align: bottom;">5,9</td><td style="text-align: center; vertical-align: bottom;">6,0</td><td style="text-align: center; vertical-align: bottom;">6,7</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">Weight (flange)</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">10,4</td><td style="text-align: center; vertical-align: bottom;">12,0</td><td style="text-align: center; vertical-align: bottom;">14,0</td></tr> </tbody> </table>		DN	15	20	25	32	40	50	L	65	70	75	100	110	130	L1	-	-	-	180	200	230	H	219	219	219	260	260	260	H1	-	-	-	260	260	260	H2	73	73	76	103	103	103	H3	-	-	-	103	103	103	Weight (thread)	3,2	3,2	3,4	5,9	6,0	6,7	Weight (flange)	-	-	-	10,4	12,0	14,0
DN	15	20	25	32	40	50																																																										
L	65	70	75	100	110	130																																																										
L1	-	-	-	180	200	230																																																										
H	219	219	219	260	260	260																																																										
H1	-	-	-	260	260	260																																																										
H2	73	73	76	103	103	103																																																										
H3	-	-	-	103	103	103																																																										
Weight (thread)	3,2	3,2	3,4	5,9	6,0	6,7																																																										
Weight (flange)	-	-	-	10,4	12,0	14,0																																																										
<b>Note:</b> Other flange dimensions - see table for tailpieces.																																																																
<b>AVPQ</b> <b>DN 15-50</b> $\Delta p = 0,2-1,0 \text{ bar}$	<b>AVPQ</b> <b>DN 32-50</b> $\Delta p = 0,2-1,0 \text{ bar}$																																																															
<b>AVPQ (<math>\Delta p = 0,2-1,0 \text{ bar}</math>)</b>																																																																
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left; padding-bottom: 2px;">DN</th><th style="text-align: center; padding-bottom: 2px;">15</th><th style="text-align: center; padding-bottom: 2px;">20</th><th style="text-align: center; padding-bottom: 2px;">25</th><th style="text-align: center; padding-bottom: 2px;">32</th><th style="text-align: center; padding-bottom: 2px;">40</th><th style="text-align: center; padding-bottom: 2px;">50</th></tr> </thead> <tbody> <tr> <td style="text-align: left; vertical-align: bottom;">L</td><td style="text-align: center; vertical-align: bottom;">65</td><td style="text-align: center; vertical-align: bottom;">70</td><td style="text-align: center; vertical-align: bottom;">75</td><td style="text-align: center; vertical-align: bottom;">100</td><td style="text-align: center; vertical-align: bottom;">110</td><td style="text-align: center; vertical-align: bottom;">130</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">L1</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">180</td><td style="text-align: center; vertical-align: bottom;">200</td><td style="text-align: center; vertical-align: bottom;">230</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H</td><td style="text-align: center; vertical-align: bottom;">175</td><td style="text-align: center; vertical-align: bottom;">175</td><td style="text-align: center; vertical-align: bottom;">175</td><td style="text-align: center; vertical-align: bottom;">217</td><td style="text-align: center; vertical-align: bottom;">217</td><td style="text-align: center; vertical-align: bottom;">217</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H1</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">217</td><td style="text-align: center; vertical-align: bottom;">217</td><td style="text-align: center; vertical-align: bottom;">217</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H2</td><td style="text-align: center; vertical-align: bottom;">73</td><td style="text-align: center; vertical-align: bottom;">73</td><td style="text-align: center; vertical-align: bottom;">76</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">H3</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td><td style="text-align: center; vertical-align: bottom;">103</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">Weight (thread)</td><td style="text-align: center; vertical-align: bottom;">3,2</td><td style="text-align: center; vertical-align: bottom;">3,2</td><td style="text-align: center; vertical-align: bottom;">3,4</td><td style="text-align: center; vertical-align: bottom;">5,9</td><td style="text-align: center; vertical-align: bottom;">6,0</td><td style="text-align: center; vertical-align: bottom;">6,7</td></tr> <tr> <td style="text-align: left; vertical-align: bottom;">Weight (flange)</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">-</td><td style="text-align: center; vertical-align: bottom;">10,4</td><td style="text-align: center; vertical-align: bottom;">12,0</td><td style="text-align: center; vertical-align: bottom;">14,0</td></tr> </tbody> </table>		DN	15	20	25	32	40	50	L	65	70	75	100	110	130	L1	-	-	-	180	200	230	H	175	175	175	217	217	217	H1	-	-	-	217	217	217	H2	73	73	76	103	103	103	H3	-	-	-	103	103	103	Weight (thread)	3,2	3,2	3,4	5,9	6,0	6,7	Weight (flange)	-	-	-	10,4	12,0	14,0
DN	15	20	25	32	40	50																																																										
L	65	70	75	100	110	130																																																										
L1	-	-	-	180	200	230																																																										
H	175	175	175	217	217	217																																																										
H1	-	-	-	217	217	217																																																										
H2	73	73	76	103	103	103																																																										
H3	-	-	-	103	103	103																																																										
Weight (thread)	3,2	3,2	3,4	5,9	6,0	6,7																																																										
Weight (flange)	-	-	-	10,4	12,0	14,0																																																										
<b>Note:</b> Other flange dimensions - see table for tailpieces.																																																																

## Dimensions (continuous)

